


LAWN SPRINKLER INSTALLATION USING A PRESSURE TYPE VACUUM BREAKER AS A BACKFLOW PREVENTER

Pressure type vacuum breakers may be installed without regards to down stream valving, making it possible to isolate an entire lawn sprinkler system with a single unit when properly located. This assembly must not be installed where it will be subject to back pressures and should be installed at least twelve inches (12") above the highest outlet. The vacuum breaker should be installed where it will be accessible for periodic testing and where, if slight spillage should occur, it would not be objectionable.

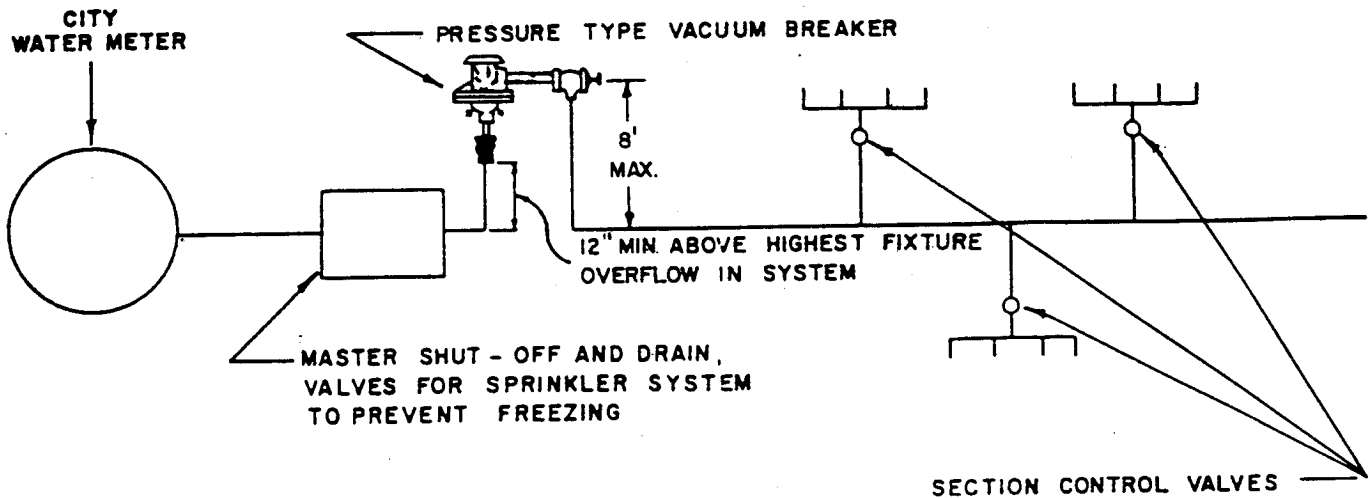

CITY OF CRIPPLE CREEK
WATER DEPARTMENT

LAWN SPRINKLER INSTALLATION USING A PRESSURE TYPE VACUUM BREAKER AS A BACKFLOW PREVENTER

DWG. NO.
47