


NOTE: SEE BLOW UP DRAWING No. 3

PLAN

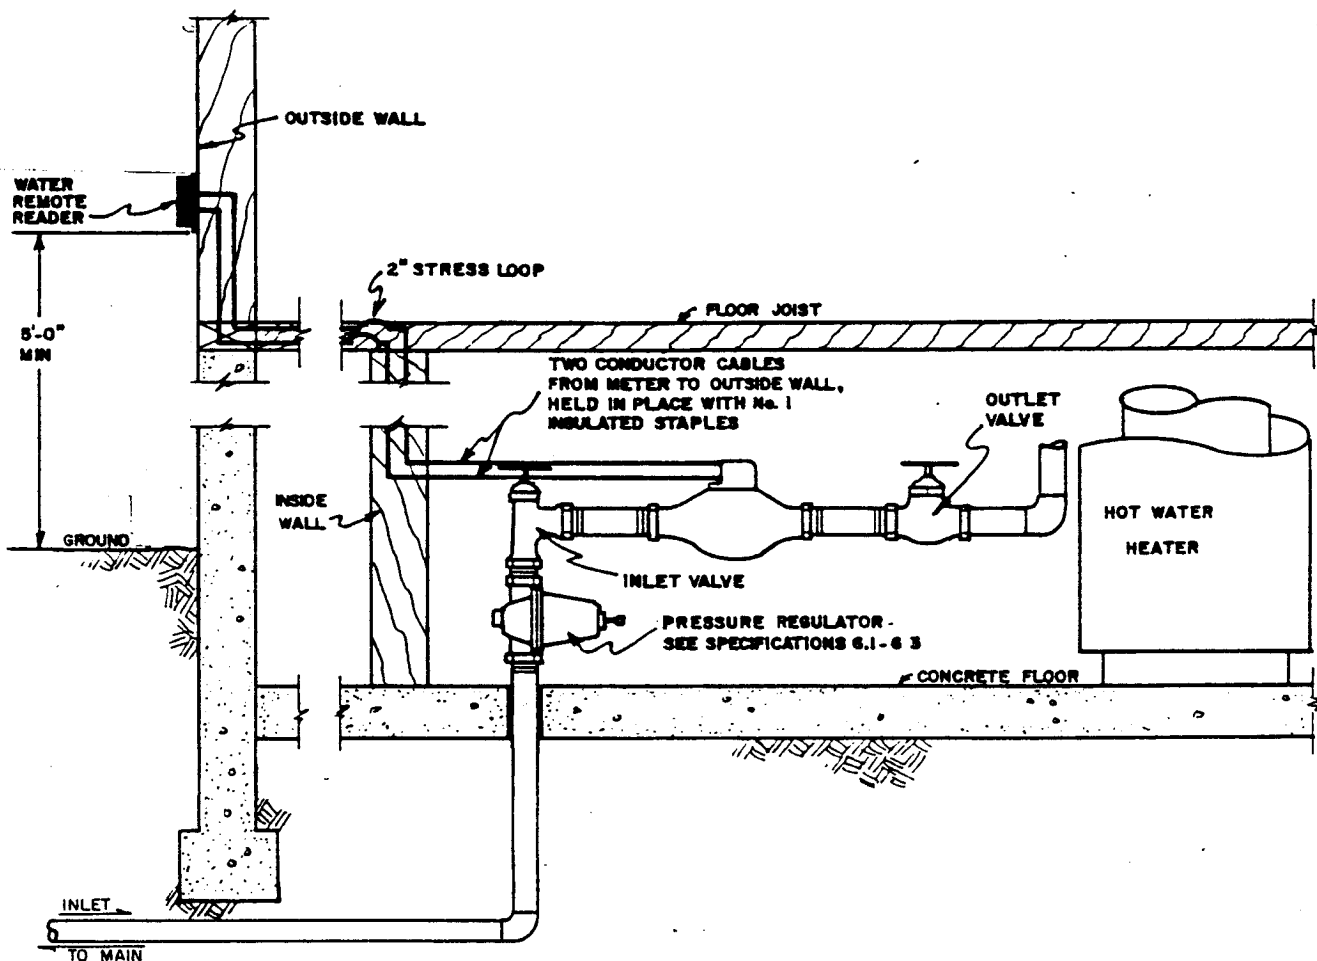

NOTES:

1. THE METER MUST BE INSTALLED WITH THE CLEARANCE DIMENSIONS AS SHOWN ABOVE AND ONE SIDE OF THE METER SHALL BE FREE FROM ANY OBSTRUCTION.
2. BRASS INLET AND OUTLET VALVES SHALL BE INSTALLED ON EACH SIDE OF THE METER. INLET AND OUTLET VALVES SHALL BE FULL OPENING, COMPRESSION VALVES WHICH CLOSE IN THE DIRECTION OF FLOW.
3. METERS TO BE INSTALLED INSIDE A RESIDENCE MUST BE LOCATED IN THE BASEMENT OR LOWER LEVEL OF THE BUILDING,
4. SEE SPECIFICATIONS.

CITY OF CRIPPLE CREEK WATER DEPARTMENT			
TYPICAL PLACEMENT FOR 5/8" THRU 1" METERS INSIDE MULTILEVEL BUILDING			
DESIGNED BY L. OTTO	CHECKED BY DATE	DATE DATE	SCALE NONE
JOB NO.		JOB NO.	
REV. NO.		REV. NO.	
			35