


PLAN

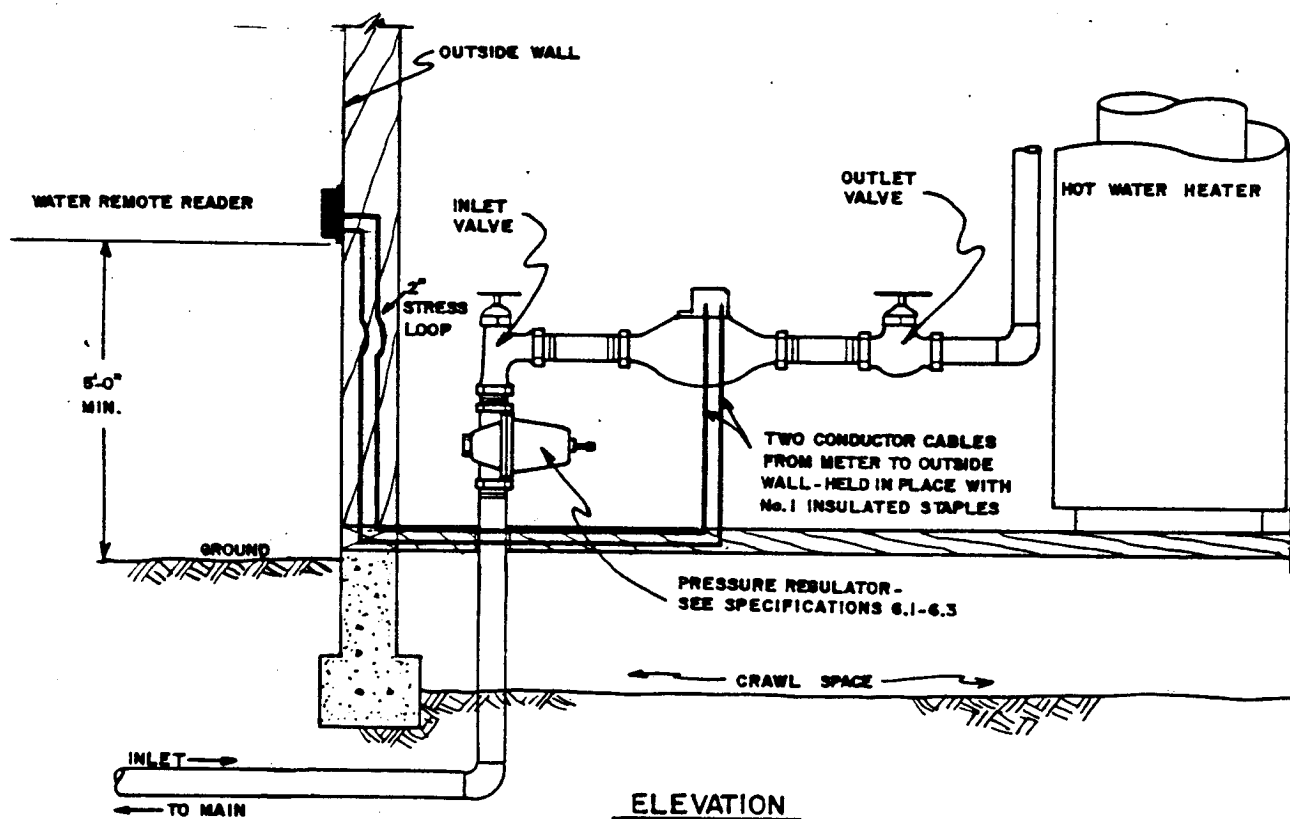

ELEVATION

**NOTES:**

1. THE METER MUST BE INSTALLED WITH THE CLEARANCE DIMENSIONS AS SHOWN ABOVE AND ONE SIDE OF THE METER SHALL BE FREE FROM ANY OBSTRUCTION.
2. BRASS INLET AND OUTLET VALVES SHALL BE INSTALLED ON EACH SIDE OF THE METER. INLET AND OUTLET VALVES SHALL BE FULL OPENING, COMPRESSION VALVES WHICH CLOSE IN DIRECTION OF FLOW.
3. METERS TO BE INSTALLED INSIDE A RESIDENCE MUST BE LOCATED IN THE BASEMENT OR LOWER LEVEL OF THE BUILDING.
4. SEE SPECIFICATIONS

<b>CITY OF CRIPPLE CREEK WATER DEPARTMENT</b>				
<b>TYPICAL INSTALLATION FOR 5/8" 3/4" AND 1" METERS INSIDE A BUILDING WITHOUT A BASEMENT</b>				
DESIGNED BY	DATE	DRAWN BY	CHECKED BY	SCALE
L. OTTO	01-1-34	343		NONE
JOB NO.		10010		
NO. OF SHEETS				
REVISION				