



**CLASS "A"**  
**(CONCRETE CRADLE)**

L.F. = 2.8

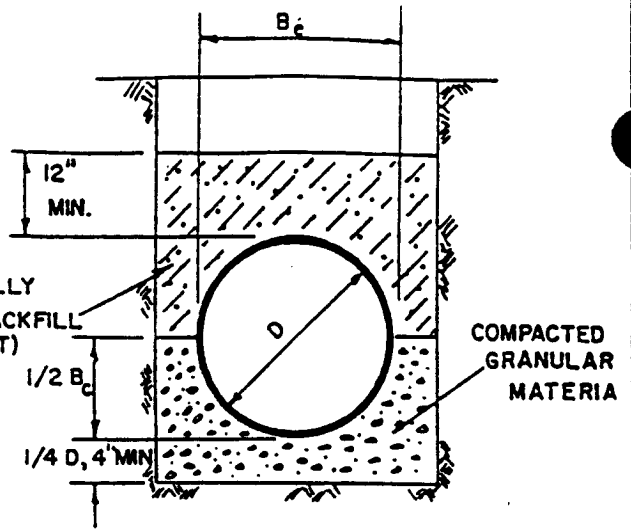


**CLASS "B"**  
**(GRANULAR BASE)**

L.F. = 1.9

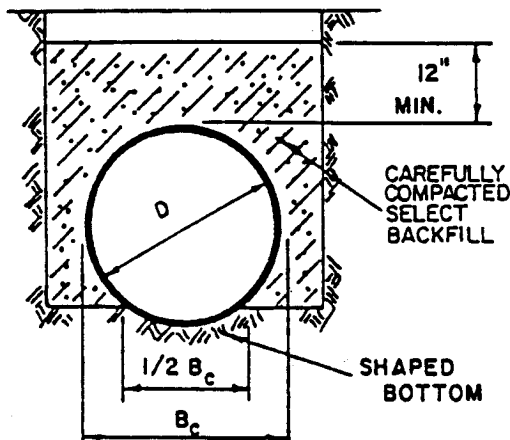

**CLASS "C"**  
**(SHAPED BOTTOM)**

L.F. = 1.5

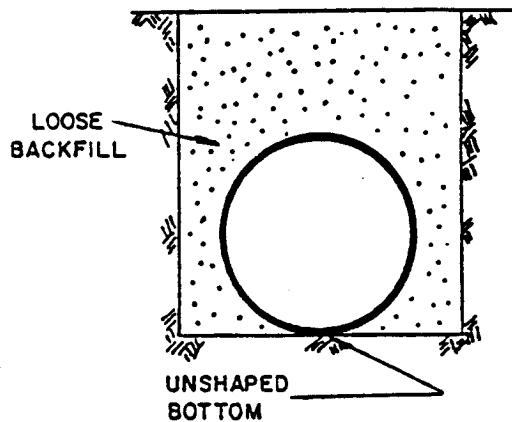

**CLASS "D"**  
**(FLAT BOTTOM)**

L.F. = 1.1

**NOTES:**

1. FOR ROCK OR OTHER INCOMPRESSIBLE MATERIALS, THE TRENCH SHALL BE OVEREXCAVATED A MINIMUM OF 6" AND REFILLED WITH GRANULAR BEDDING MATERIAL AS DEFINED BY CLASS "B" BEDDING.
2. L.F. = LOAD FACTOR
3. CLASS "D" BEDDING WILL NOT BE ACCEPTABLE UNDER ANY CONDITION.
4. MINIMUM DENSITY FOR CAREFULLY COMPACTED SELECT BACKFILL SHALL BE 95% OF STD. PROCTOR DENSITY OR AS SPECIFIED FOR THE TRENCH BACKFILL, WHICHEVER IS GREATER.

CITY OF CRIPPLE CREEK

PIPE BEDDING