




CLASS "A"
(CONCRETE CRADLE)
 L.F. = 2.8

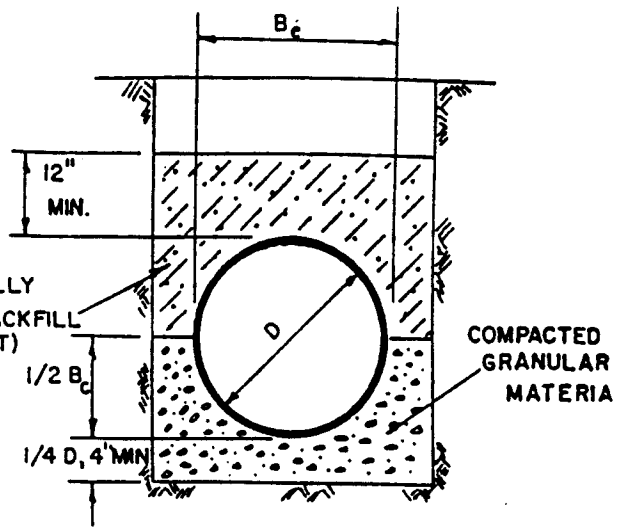

CLASS "B"
(GRANULAR BASE)
 L.F. = 1.9

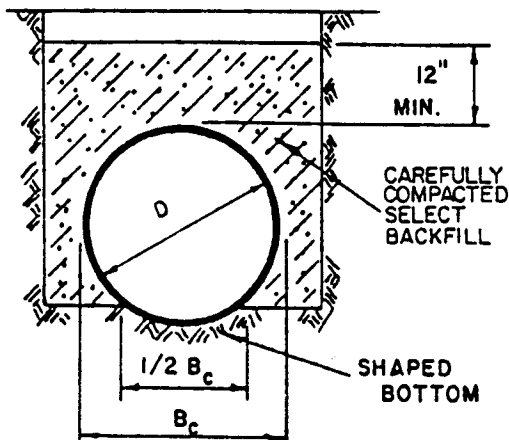

CLASS "C"
(SHAPED BOTTOM)
 L.F. = 1.5

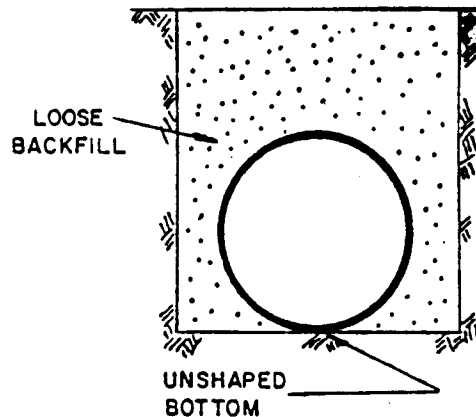

CLASS "D"
(FLAT BOTTOM)
 L.F. = 1.1

NOTES:

1. FOR ROCK OR OTHER INCOMPRESSIBLE MATERIALS, THE TRENCH SHALL BE OVEREXCAVATED A MINIMUM OF 6" AND REFILLED WITH GRANULAR BEDDING MATERIAL AS DEFINED BY CLASS "B" BEDDING.
2. L.F. = LOAD FACTOR
3. CLASS "D" BEDDING WILL NOT BE ACCEPTABLE UNDER ANY CONDITION.
4. MINIMUM DENSITY FOR CAREFULLY COMPACTED SELECT BACKFILL SHALL BE 95% OF STD. PROCTOR DENSITY OR AS SPECIFIED FOR THE TRENCH BACKFILL, WHICHEVER IS GREATER.