



PLAN

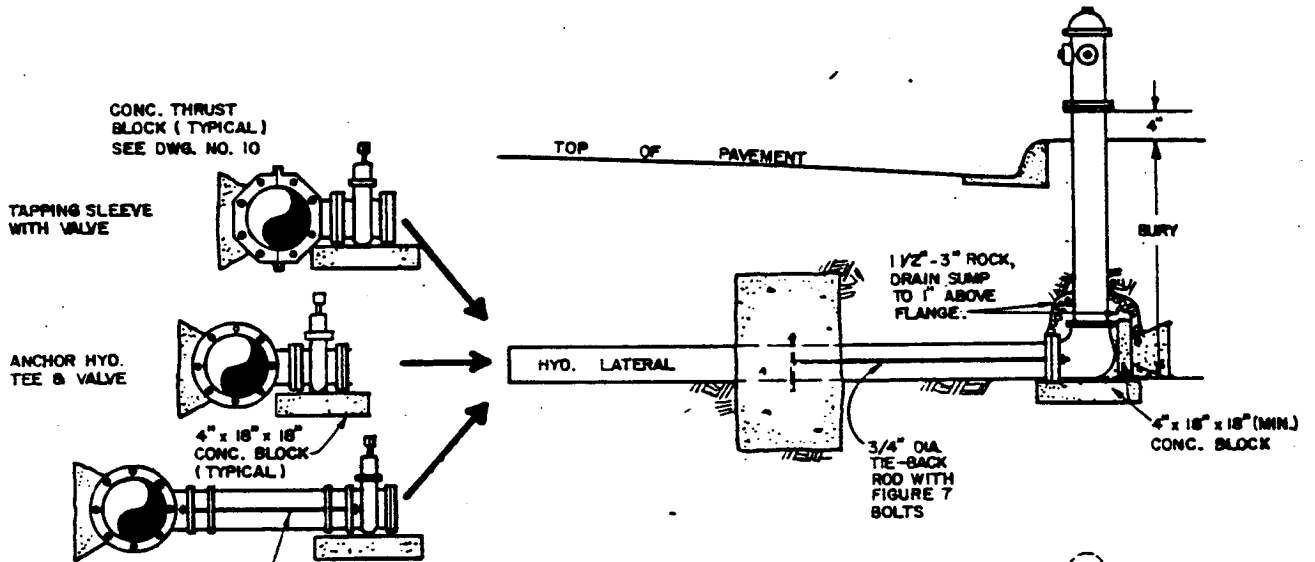

PROFILE showing 3 acceptable valve and tee fittings.

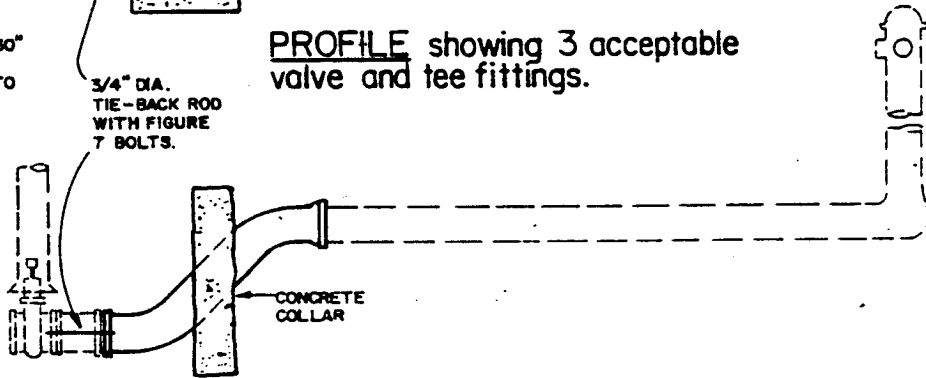

PROFILE showing typical vertical offset bend upon inspectors approval.

CITY OF CRIPPLE CREEK WATER DEPARTMENT				
FIRE HYDRANT INSTALLATION				
Drawn	L OTTO	DATE	08/11/98	Scale: NONE
Approved		DATE		Scale: NONE
JOB NO.		DATE		
REVISION				
REVISION				
				5